Blank Bodies for Brazed Hubs

UNILETS™ for Use with Threaded Rigid Metal Conduit and IMC. Available with Hub Sizes from 1/2" through 1-1/2" (Union 1/2" through 1-1/4"). Furnished with Internal Ground Screw.

NEC: Listed for Ordinary Locations

Applications

- · Accommodate wiring devices such as switches and receptacles.
- Provide excellent service in areas where boxes are subject to rough usage.
- Serve as pull boxes for conductors.
- Permit access to conductors for maintenance.
- Provide openings for making splices.
- Allow connections for branch conduit runs.
- Blank bodies for special conduit entrance arrangements.

Features

- Corrosion-resistant ideal for indoor and outdoor installations.
- Weatherproof, raintight and dust-tight when used with cast gasketed covers.
- FS and FD boxes take standard flush wiring devices.
- FD boxes take devices exceeding 1-5/8" in depth under fastening ears.
- Malleable iron for high tensile strength and ductility provides greater resistance to impact and shock.
- Both malleable iron and aluminum boxes have ridge top construction for positive cover/gasket/box fit.
- Accurately tapped, tapered threads for tight, rigid joints, ground continuity.
- Complete selection of covers, receptacles, plugs, gaskets and accessories.
- Covers have captive screws to speed installation, prevents loss of screws.
- Internal grounding screws standard.
- Available in single, two, three and four gang boxes.
- Brazed threaded hubs for threaded conduit from 1/2" thru 1-1/2" and brazed union hubs from 1/2" thru 1-1/4.
- Smooth, rounded integral bushing in each hub protects conductor insulation.

Standard Materials

- Brazed hub device boxes: malleable iron
- Brazed hubs: malleable iron
- Covers: malleable iron or steel
- Cover screws: stainless steel, 6-32 thread

Standard Finishes

- Malleable iron boxes and covers: triple-coat (1) zinc electroplate, (2) chromate, and (3) epoxy powder coat
- Steel covers: zinc electroplate

NEC Certifications and Compliances

- UL Standard: 514A
- UL Listed: E2527
- NEMA Standard: FB-1

Reference Data

When ordering drilled and tapped openings or brazed hubs for blank bodies, refer to FDH Cast Device Boxes Drilling and Tapping Information pages.



Blank Bodies for Drilling and tapping. FD-3L shown.



Blank Bodies for Brazed Hubs. FS-3G shown.

EMERSON

Blank Bodies for Brazed Hubs

UNILETS™ for Use with Threaded Rigid Metal Conduit and IMC. Available with Hub Sizes from 1/2" through 1-1/2" (Union 1/2" through 1-1/4"). Furnished with Internal Ground Screw.

NEC: Listed for Ordinary Locations

		Depth	Catalog Number
	Description	(2.69" Deep with Lugs)	Malleable Iron Ridge Top
Single-Gang Box			
O Description of the second of	Use with single-gang covers	Deep	FD-1L
Two-Gang Box, Multiple Cover			
"UNILETS"	Use with single-gang covers	Deep	FD-2L
Three-Gang Box, Multiple Cover			
	Use with single-gang covers	Deep	FD-3L
Four-Gang Box, Multiple Cover			
O'UNILETS"	Use with single-gang covers	Deep	FD-4L

Blank Bodies for Brazed Hubs

UNILETS™ for Use with Threaded Rigid Metal Conduit and IMC. Available with Hub Sizes from 1/2" through 1-1/2" (Union 1/2" through 1-1/4"). Furnished with Internal Ground Screw.

NEC: Listed for Ordinary Locations

FS Box (Shallow) 2.00", FD Box (Deep) 2.69"

FS Box (Shallow) 2.00", FD Box (Deep)	Brazed Hubs Description	Depth	Catalog Number Malleable Iron Ridge Top
FS and FD with Lugs	·	-	
	Single-Gang Box	Shallow	FS-1GL
	Two-Gang Box	Shallow	FS-2GL
	Single Cover	Deep	FD-2GL
	Three-Gang Box	Shallow	FS-3GL
9	Single Cover	Deep	FD-3GL
	Four-Gang Box	Shallow	FS-4GL ①
	Single Cover	Deep	FD-4GL
FS and FD without Lugs			
	Two-Gang Box	Shallow	FS-2G ①
	Single Cover	Deep	FD-2G
	Three-Gang Box	Shallow	FS-3G ①
	Single Cover	Deep	FD-3G
£	Four-Gang Box	Shallow	FS-4G ①
	Single Cover	Deep	FD-4G

 $\ensuremath{\mathbb{O}}$ Not furnished with internal ground screw.



NEC: Listed for Ordinary Locations

		Catalog	Number
	Description	Malleable Iron	Steel
3	Stamped Steel Covers		
	Furnished with stainless steel screws, less gasket For square handle tumbler or toggle flush switches	_	FSK-4TS
*	Malleable Iron Cast Covers - Weatherproof		
	Furnished with gasket and stainless steel screws Blank Cast	FSK-4B-CM	_
	Gasket - Replacement		
	Neoprene — for use with 4-gang cast covers above	FS-GKR-4N	FS-GKR-4

Single-, Two-, Three-, and Four-Gang Boxes. Brazed Threaded Hubs for Rigid Conduit, 1/2" through 1-1/2"; Brazed Union Hubs, 1/2" through 1-1/4".

NEC:

Listed for Ordinary Locations

Determine catalog number as follows:

- (1) Select FDH device box catalog number;
- (2) Select "Standard Hub Arrangement Diagram" number;
- (3) Detemine if your desired number and trade size of conduit entries will fit in the FDH box choosen, by reviewing the "Maximum Number and Size..." table on page B-25. Select a larger box if you experience a fit problem: and
- (4) Delect symbols that represent hub sizes from "Symbol Table." (Use "0" where no hub is required, and separate the various divisions of the complete catalog number by dashes.)

Example:

The blank body device box selected is FS-3GL and the hub arrangement is diagram #8. Hub "a" is to be 1/2" BRAZED THREADED; hub "b", 1" BRAZED THREADED; hub "c", 3/4" BRAZED THREADED; hub "d", no hub is required; and hub "e", 1-1/4" BRAZED UNION.

The complete catalog number will be: FS-3GL-8-1320U

If a "Standard Hub Arrangement" is not suitable for the application, or when hubs are to be more accurately spaced, submit sketch locating hubs (1) from centerlines of walls and (2) from outside back of box (or from mounting lug surface if lugs are supplied).

All hubs will be located in centerlines of walls and evenly spaced unless otherwise specified.


Symbol Table

Hub Size (Inches)	Brazed Threaded Hub Symbol	Brazed Union Hub Symbol
Blank	0	0
1/2	1	R
3/4	2	s
1	3	Т
1-1/4	4	U
1-1/2	5	_


Standard Conduit Opening Arrangement Diagrams

Hub "a" is always TOP of box

Two, Three and Four Gang (Front View)

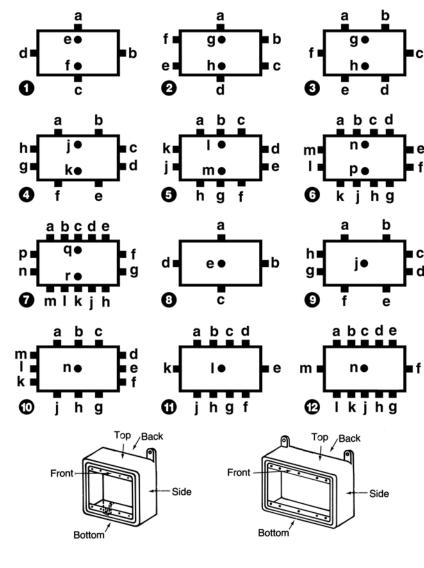

One Gang (Front View)

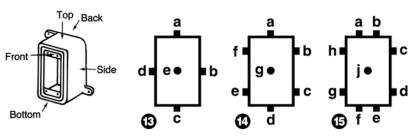



Single-, Two-, Three-, and Four-Gang Boxes. Brazed Threaded Hubs for Rigid Conduit, 1/2" through 1-1/2"; Brazed Union Hubs, 1/2" through 1-1/4".

NEC: Listed for Ordinary Locations


Minimum Centerline Spacing Between Brazed Threaded Hubs ①

Table shows minimum distances between hub centerlines in various size combinations. For example, if 1-1/4" and 1/2" openings are to be brazed on one side of box, the minimum spacing between centerlines would be 1.75". If union hubs are used, additional space must be allowed.

Minimum Centerline Spacing in Inches

Millindin Centerline Spacing in Inches					
Hub Size					
(Inches)	1/2	3/4	1	1–1/4	1–1/2
1/2	31.8 (1.25)				
3/4	35.1 (1.38)	38.1 (1.50)			
1	39.6 (1.56)	42.9 (1.69)	46.0 (1.81)		
1-1/4	44.5 (1.75)	47.8 (1.88)	50.8 (2.00)	55.6 (2.19)	
1-1/2	49.3 (1.94)	52.3 (2.06)	55.6 (2.19)	60.5 (2.38)	65.0 (2.56)
Hub Dia.	28.7 (1.13)	35.0 (1.38)	41.4 (1.63)	50.8 (2.00)	60.5 (2.38)
Conduit Dia.	22.4 (0.88)	26.9 (1.06)	33.3 (1.31)	42.9 (1.69)	49.3 (1.94)
UNY/UNF Union Dia.	38.1 (1.50)	44.5 (1.75)	50.8 (2.00)	71.4 (2.81)	_

Distance from Mounting Surface to Centerline of Brazed Threaded Hubs



Hub Size (Inches)		Dimensions "A" Millimeters (Inches)
	1/2	16.0 (0.63)
	3/4	19.1 (0.75)
	1	22.4 (0.88)
	1-1/4	27.7 (1.09)
	1-1/2	31.0 (1.22)

Maximum Number and Sizes of Drilled and Tapped Conduit Openings Per Top, Bottom, Side and Back ① Allowance made for clearance over Appleton™ BBU Series bushings.

Max. No. Of Openings Max. No. Of Openings **Hub Size Hub Size** Per Side **Top or Bottom** Per Side Type Box (Inches) **Top or Bottom** Type Box (Inches) **Back** Back 1/2 2 2 1/2 6 1 2 FS-3G and FD-1L 3/4 1 2 3/4 3 2 6 1 FS-3GL One 1 1 2 1 One 1 3 2 6 Single-Gang Three-Gang 1-1/4 1 1 1 1-1/4 None None 3 Cover Cover 1-1/21 1 1-1/2None None 3 1/2 4 2 4 1/2 5 2 8 FS-4G and FD-2L 3/4 2 2 4 3/4 4 2 8 FS-4GL 2 2 4 2 8 4 One 1 1 Single Gang Four Gang 2 2 4 1-1/4 1 1-1/4None None Covers Cover 1 - 1/22 2 1-1/2None None 4 1/2 6 2 6 1/2 3 2 4 FD-2G and FD-3L 3/4 3 2 6 3/4 2 2 4 FD-2GL Three 3 2 6 2 2 4 1 One 1 Single Gang Two Gang 1-1/4 3 3 1-1/4 2 1 1 1 Covers Cover 3 3 2 1-1/21-1/21 1 1 2 4 2 6 1/2 8 8 1/2 FD-3G and FD-4L 3/4 4 2 8 3/4 3 2 6 FD-3GL Four 4 2 8 3 2 6 1 One 1 Single Gang Three Gang 1-1/4 4 1 4 1-1/4 2 1 3 Covers Cover 1-1/2 4 1 4 1-1/22 1 3 1/2 2 2 1 1/2 5 2 8 FD-4G and FS-1GL 3/4 1 2 1 FD-4GL 3/4 4 2 8 One 1 1 2 1 One 1 4 2 8 Single Gang Four Gang 1-1/4 None None 1-1/4 3 1 4 1 Cover Cover 3 1-1/2None None 1-1/21/2 3 2 4 FS-2G and 3/4 2 4 2 FS-2GL

4

2

2

None

None



1

1-1/4

1-1/2

One

Cover

Two Gang

2

None

None

² 10 Hubs will be located in center of walls and evenly spaced unless otherwise specified. Where spacings are critical, submit sketch showing exact spacing requirements.

FDH Single and Multiple Gang Cast Device Boxes Blank Bodies for Brazed Hubs.


NEC: Listed for Ordinary Locations


Wiring Capacity

	Capacity — dm³ (in³)			
Gangs	Catalog Number	Volume	Catalog Number	Volume
Single	FS-1GL	0.29 (18.00)	FD-1L	0.43 (26.00)
Two	FS-2G	0.52 (32.00)	FD-2G, FD-2GL	0.74 (45.00)
Two	FS-2GL	0.52 (32.00)	FD-2L	1.07 (65.00)
Three	FS-3G	0.75 (46.00)	FD-3G, FD-3GL	1.02 (62.00)
Three	FS-3GL	0.75 (46.00)	FD-3L	1.61 (98.00)
Four	FS-4G	0.95 (58.00)	FD-4G, FD-4GL	1.28 (78.00)
Four	FS-4GL	0.95 (58.00)	FD-4L	2.13 (130.00)

Dimensions in Millimeters (Inches)

Single, Multiple Gang Boxes with Multiple Covers

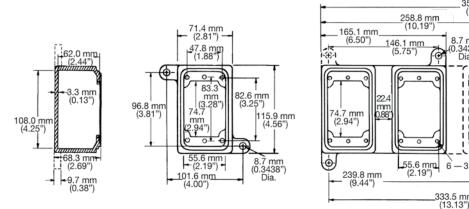

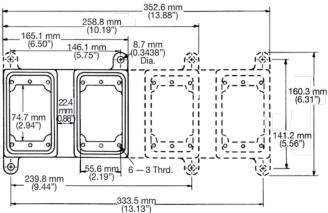



Blank Bodies for Brazed Hubs.


NEC: Listed for Ordinary Locations

Dimensions in Millimeters (Inches)


Two and Three Gang Single Cover Boxes








FS and FD Four Gang Single Cover Boxes



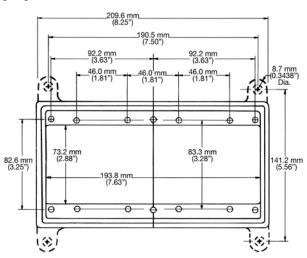

	A		В
"FS"	"FD"	"FS"	"FD"
50.8 (2.00)	68.3 (2.69)	45.2 (1.78)	62.0 (2.44)